
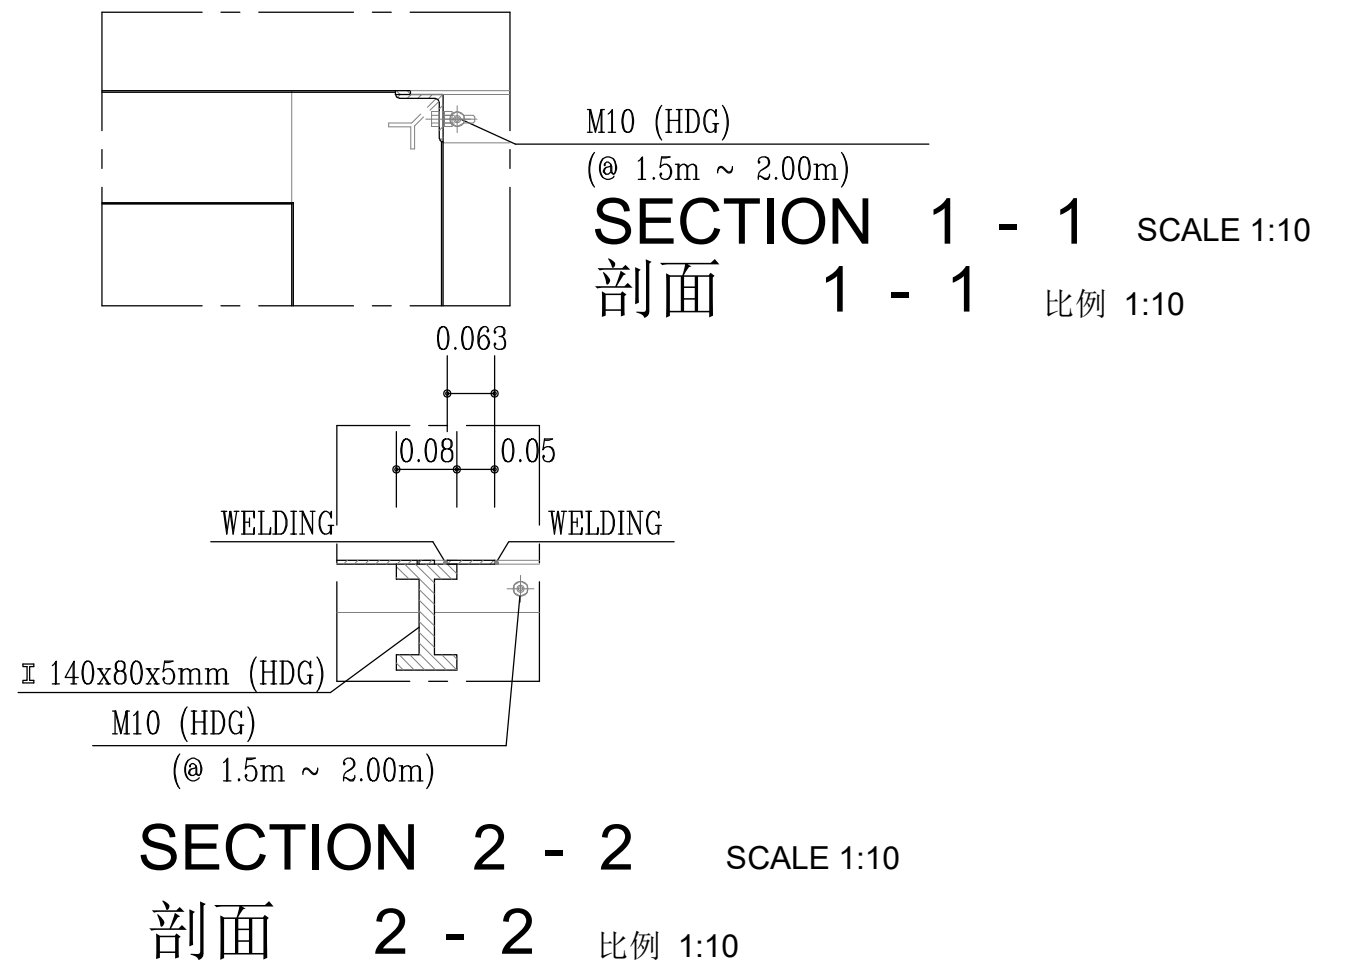
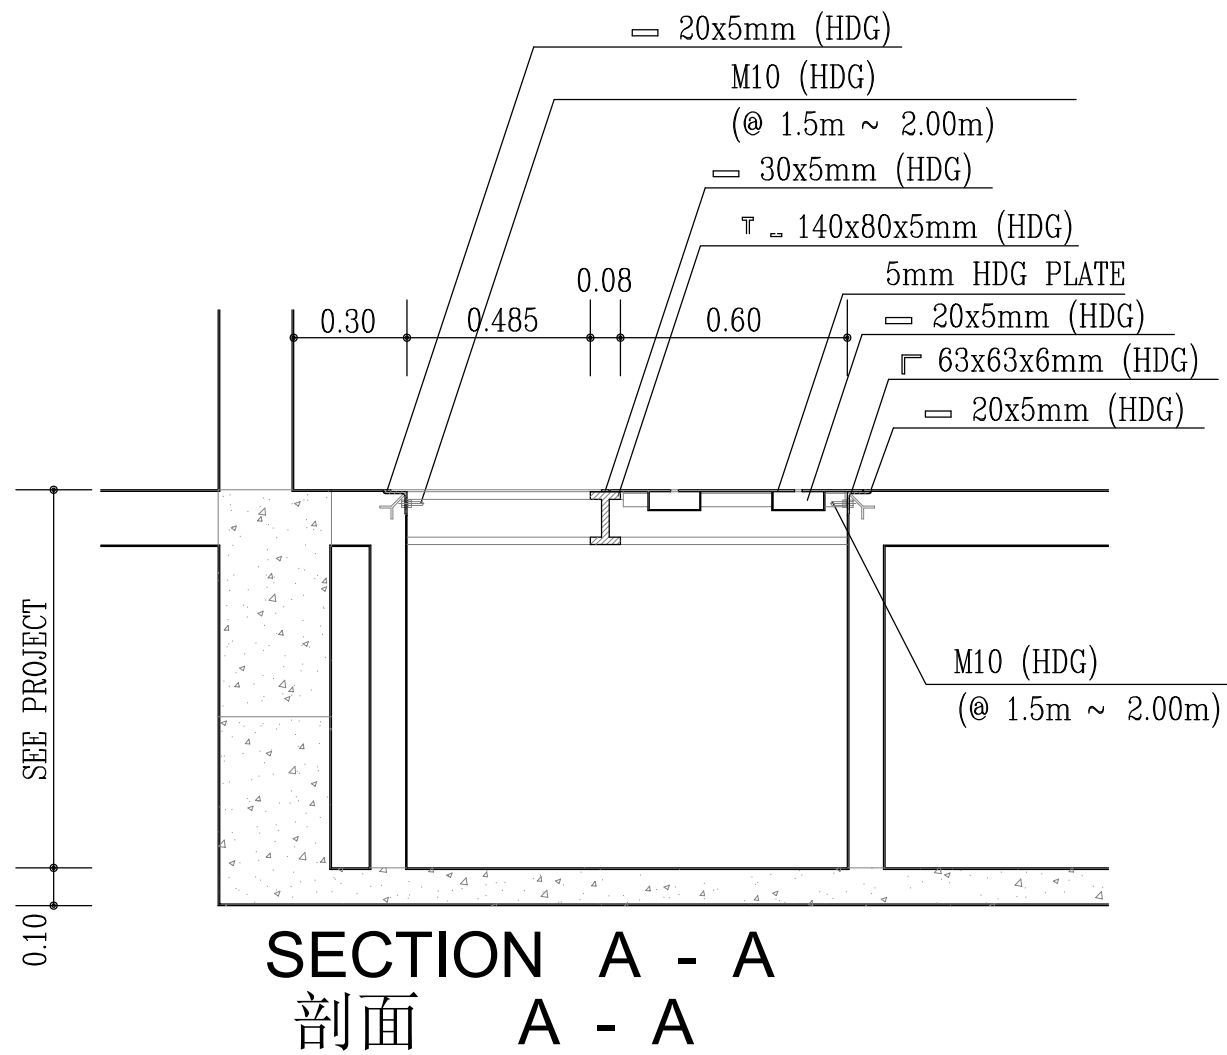



TYPE 1

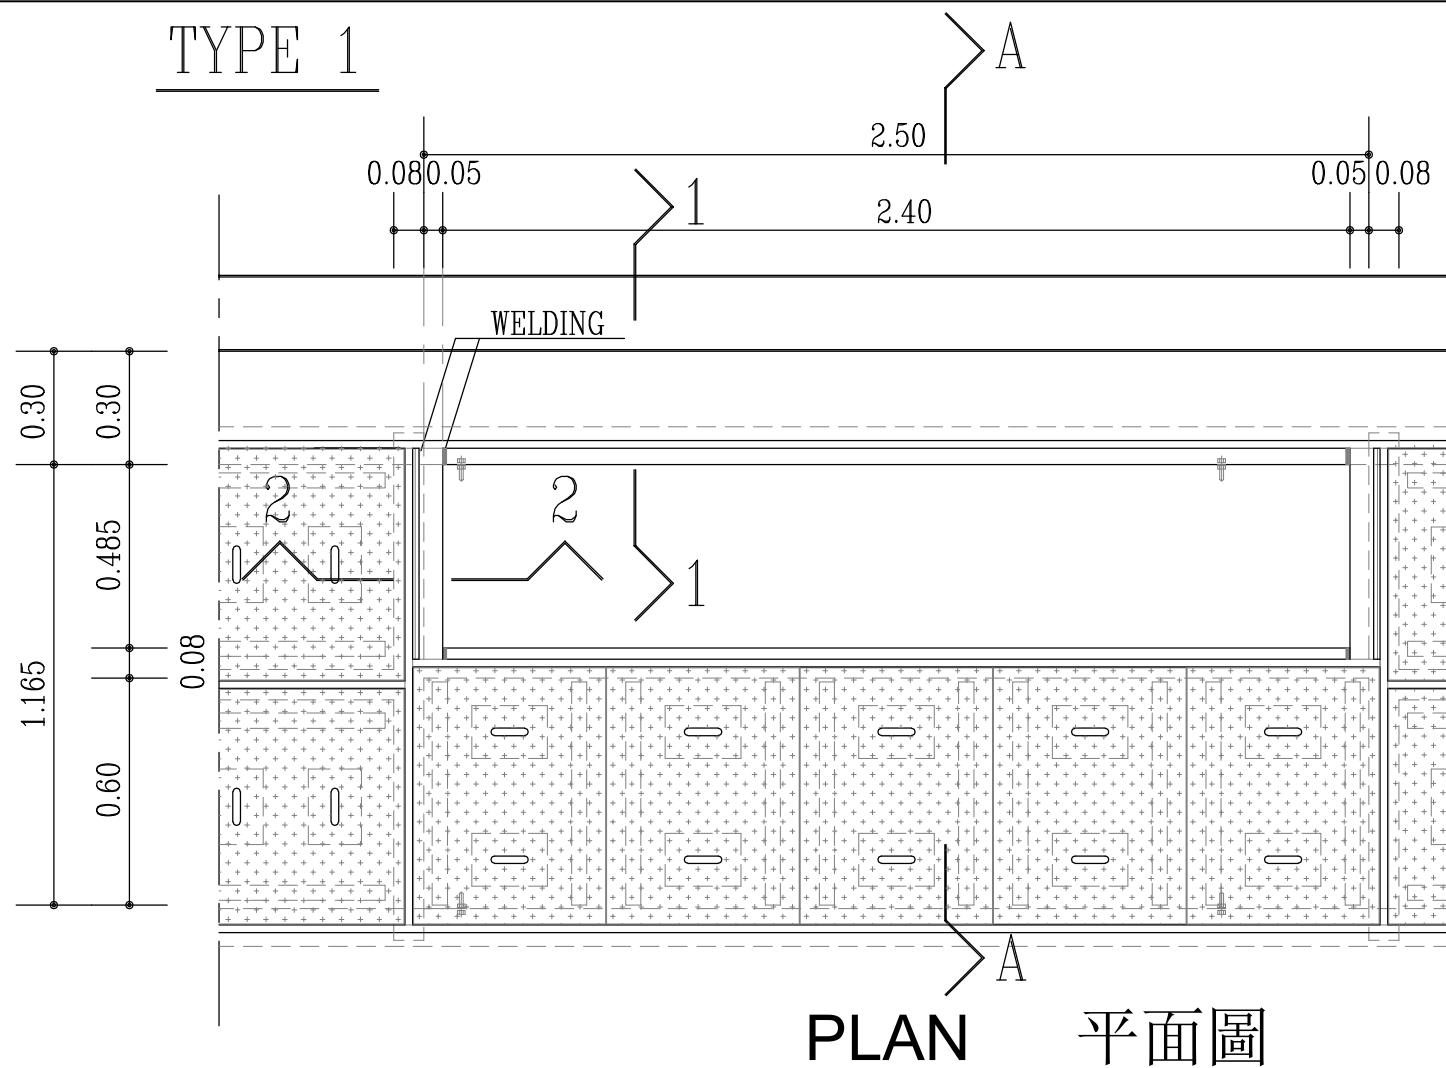

NOTE 注意
All structure in HDG (Hot dip galvanized) 所有材料用HDG
0.25m min. distance between wall and cable trench 由牆身至線槽邊距離最少 0.25m
PVC cable piping arrangement (cement between pipes min. 30mm) 電纜膠喉排列距離最少 30mm
PVC cable duct sealing 電纜膠管防滲水
Cable gutters free of water 線槽不得積水
All screws and expansion screws fix with rings 安裝所有螺絲要用介子
All screws and expansion screws for earthing must be HDG 安裝所有螺絲為地氣要用HDG

D					
C					
B					
A					
	Date	Modification	Draft.	Verif.	Approv.

Draft.	Hou	04/01/2012	Customer Substation (P.T.) Civil Construction	
Verif.	Wanda	04/01/2012		
Approv.	Wanda	04/01/2012		
Cable trench and matallic cover for Q.G.B.T. 用於低壓掣板的電纜線坑和金屬蓋				TAD
Scale 1 : 20 & 1 : 10	Remarks		Job N ^o	Drawing N ^o D-334