



PLAN (3 PANELS)

平面圖 (3 位)

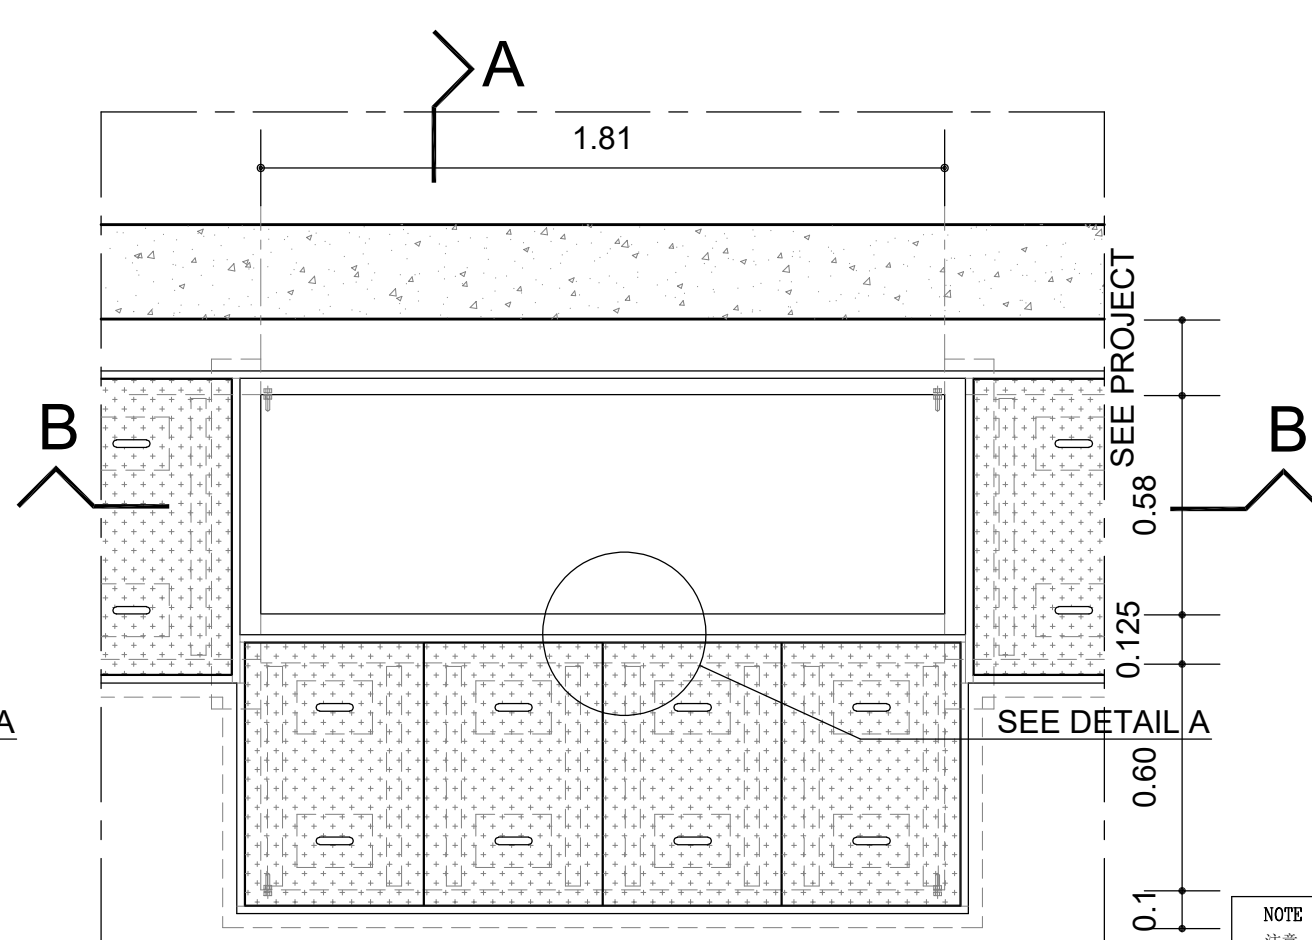


PLAN (4 PANELS)

平面圖 (4 位)

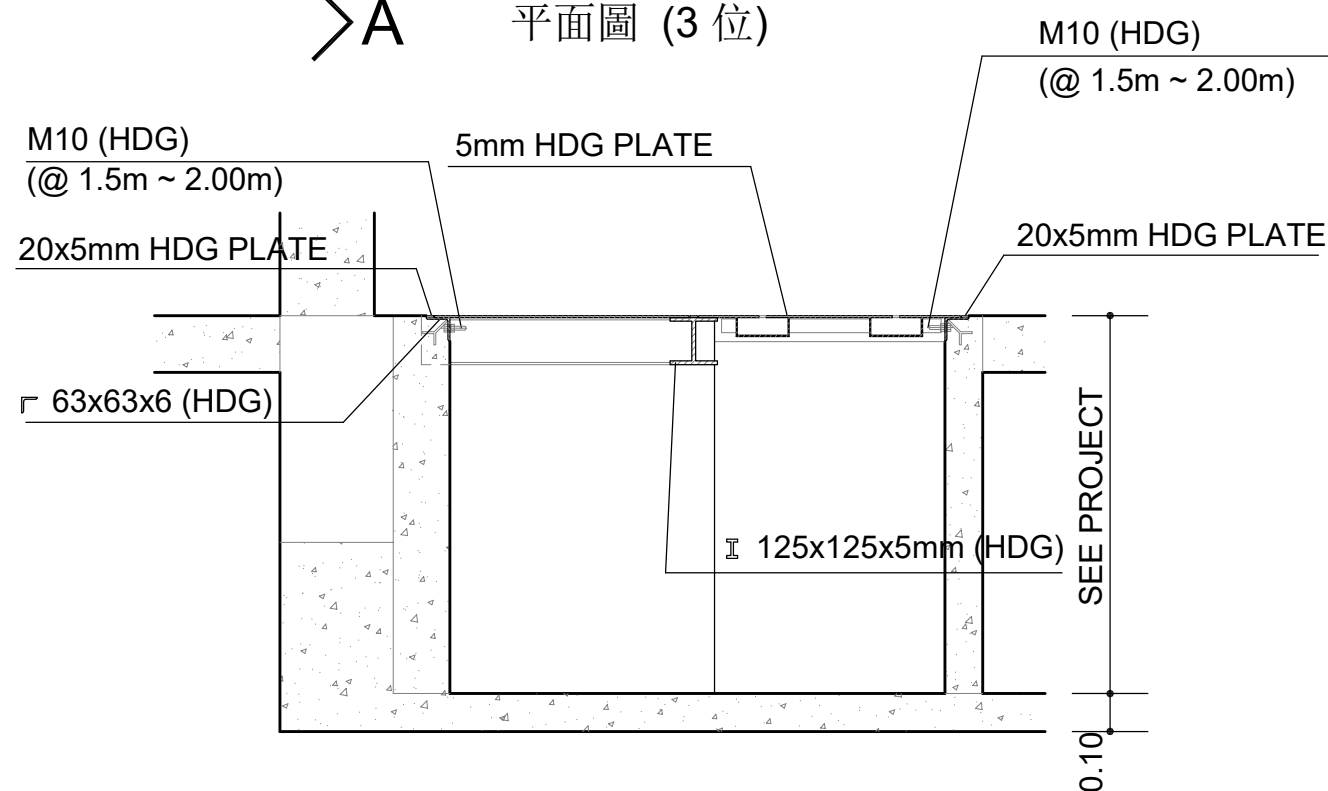


SECTION A - A 剖面 A - A

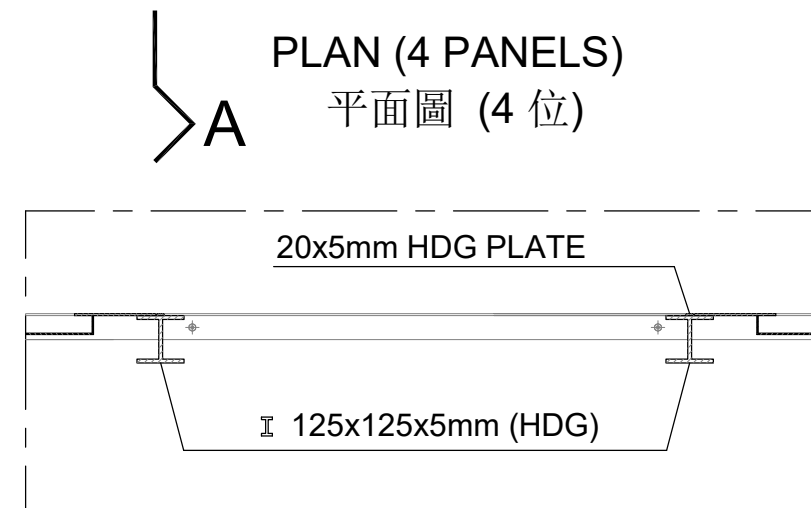

SECTION B - B 剖面 B - B

NOTE
注意
All structure in HDG (Hot dip galvanized) 所有材料用 HDG
Distance from wall to support frame ( min. 0.25m ) 由牆身至線槽邊距離最小 0.25m
HDG support frame (New P.T. ) HDG 支撐架 (新電房)
Installation and elevation of the support frame ( New P.T. ) 安裝支撐架 (新電房)
HDG cable cover with slat HDG 線槽蓋要有花紋
PVC cable duct sealing 電纜膠管防滲水
Cable gutters free of water 線槽不得積水
All screws and expansion screws fix with rings 安裝所有螺絲要用介子
All screws and expansion screws for earthing must be HDG 安裝所有螺絲為地氣要用HDG

D				
C				
B				
A				
	Date	Modification	Draft.	Verif.
			Approv.	

Draft.	Marco	14/09/2015	Customer Substation (P.T.) Civil Construction	
Verif.	V. Lopes	24/09/2015		
Approv.	Billy	30/09/2015		
Cable trench for R.M.U. 環網開關櫃的電纜線坑				TAD
Scale 1 : 20		Remarks		Job Nº
				Drawing Nº E-556