




PLAN 平面圖

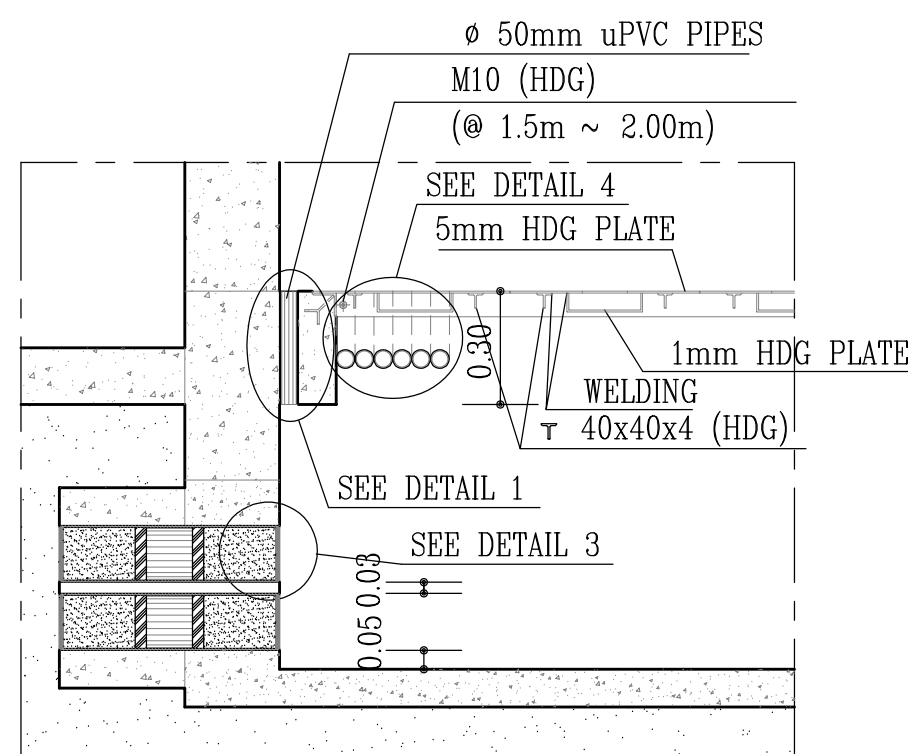


SECTION A - A
剖面 A - A

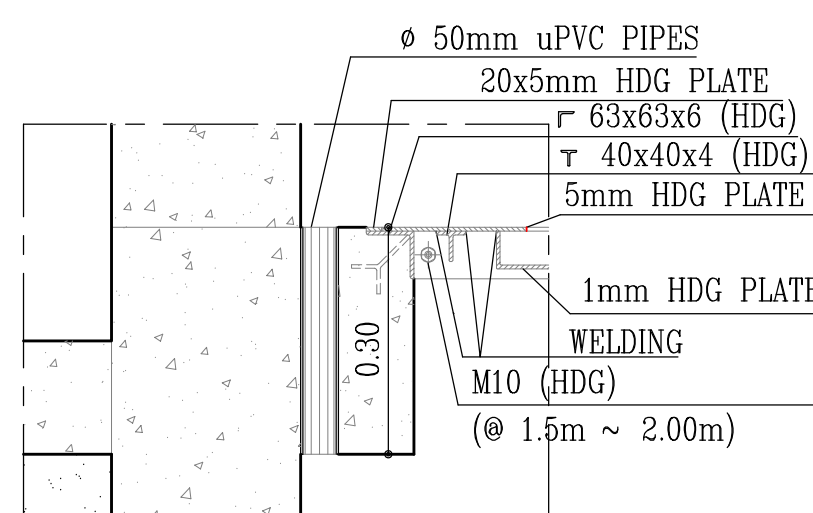


DETAIL 1 SCALE 1:10
詳圖 1 比例 1:10

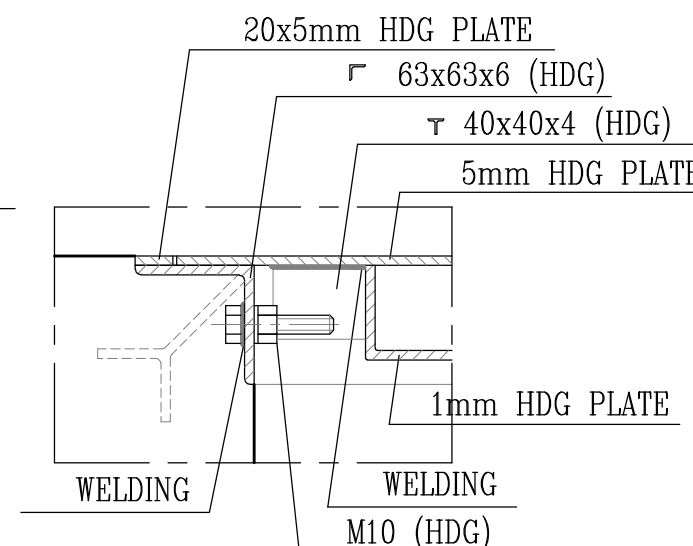


DETAIL 2 SCALE 1:4
詳圖 2 比例 1:4

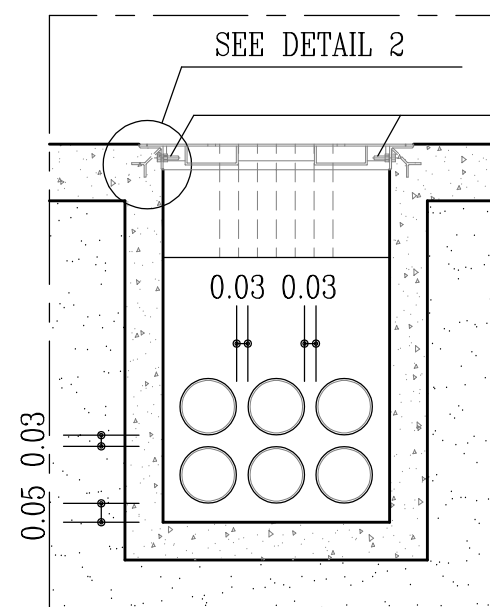

SECTION B - B
剖面 B - B

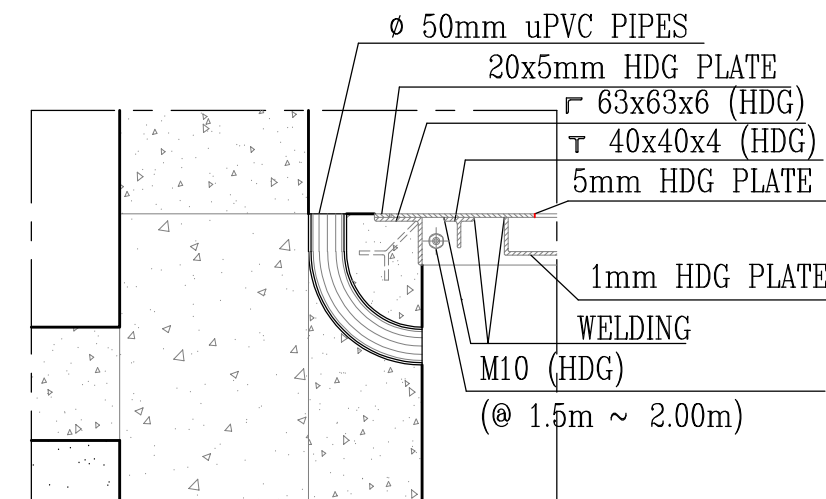


DETAIL 4 SCALE 1:10
詳圖 4 比例 1:10

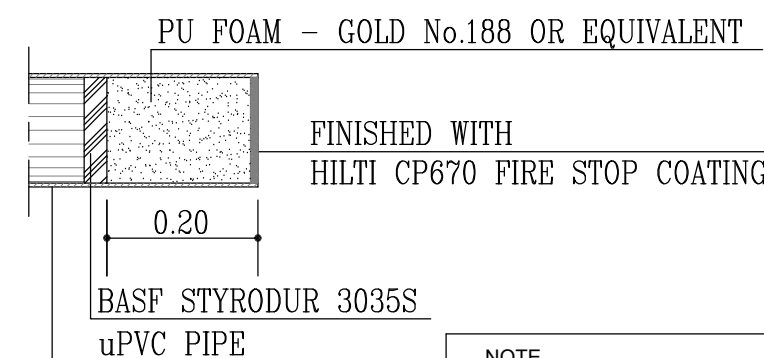

DETAIL 3 SCALE 1:10
詳圖 3 比例 1:10

NOTE 注意
All structure in HDG (Hot dip galvanized) 所有材料用 HDG
HDG cable cover with slat HDG 線坑蓋要有花紋
PVC cable piping arrangement (cement between pipes min. 30mm) 電纜膠喉排列距離最小 30mm
PVC cable duct sealing 電纜膠管防滲水
Cable gutters free of water 線槽不得積水
All screws and expansion screws fix with rings 安裝所有螺絲要用介子
All screws and expansion screws for earthing must be HDG 安裝所有螺絲為地氣要用HDG

D					
C					
B	29/07/2019	Modify the material to block the uPVC pipes	Hou	Rachel	
A	18/02/2004	To add earthing terminal in the cable trench @ 1.50m ~ 2.00m	Hou	Tavares	Tavares
	Date	Modification	Draft.	Verif.	Approv.

Draft.	Hou	21/04/1986	Customer Substation (P.T.) Civil Construction		
Verif.	Wanda	21/04/1986			
Approv.					
Steel cover for cable trench 電纜線坑的板蓋				TAD	
Scale 1 : 10, 1 : 20 & 1 : 4		Remarks		Job N°	Drawing N° E-105