



| NOTE 注意 | |
|---|---|
| Galvanized air duct 電鍍抽氣槽 | Exhaust fan 抽氣扇 |
| 3mm thick anti-vibration rubber 3mm 厚避震膠 | (1) 不用指定牌子 (2) 24" (3) 230V 50Hz (4) >=7000m3/h (5) >=50Pa (6) Fixed speed |
| N#24 galvanized air duct with anti-corrosion painting #24 電鍍抽氣槽板雖要油防鏽油 | |
| Manhole opening and door 抽氣槽開門 | 5mm thick anti-vibration rubber 5mm 厚避震膠 |
| Stainless steel support / hang frame 不鏽鋼抽氣槽支撐架 | Anti-corrosion painting 防鏽油 |
| All screws and expansion screws fix with rings 安裝所有螺絲要用介子 | The screws fix the exhaust fan with rings and 5mm rubber 安裝抽氣扇要用介子和5mm 膠 |
| All screws and expansion screws must be stainless steel 安裝所有螺絲要用不鏽鋼品種 | |
| HDG - Hot dip galvanized | |

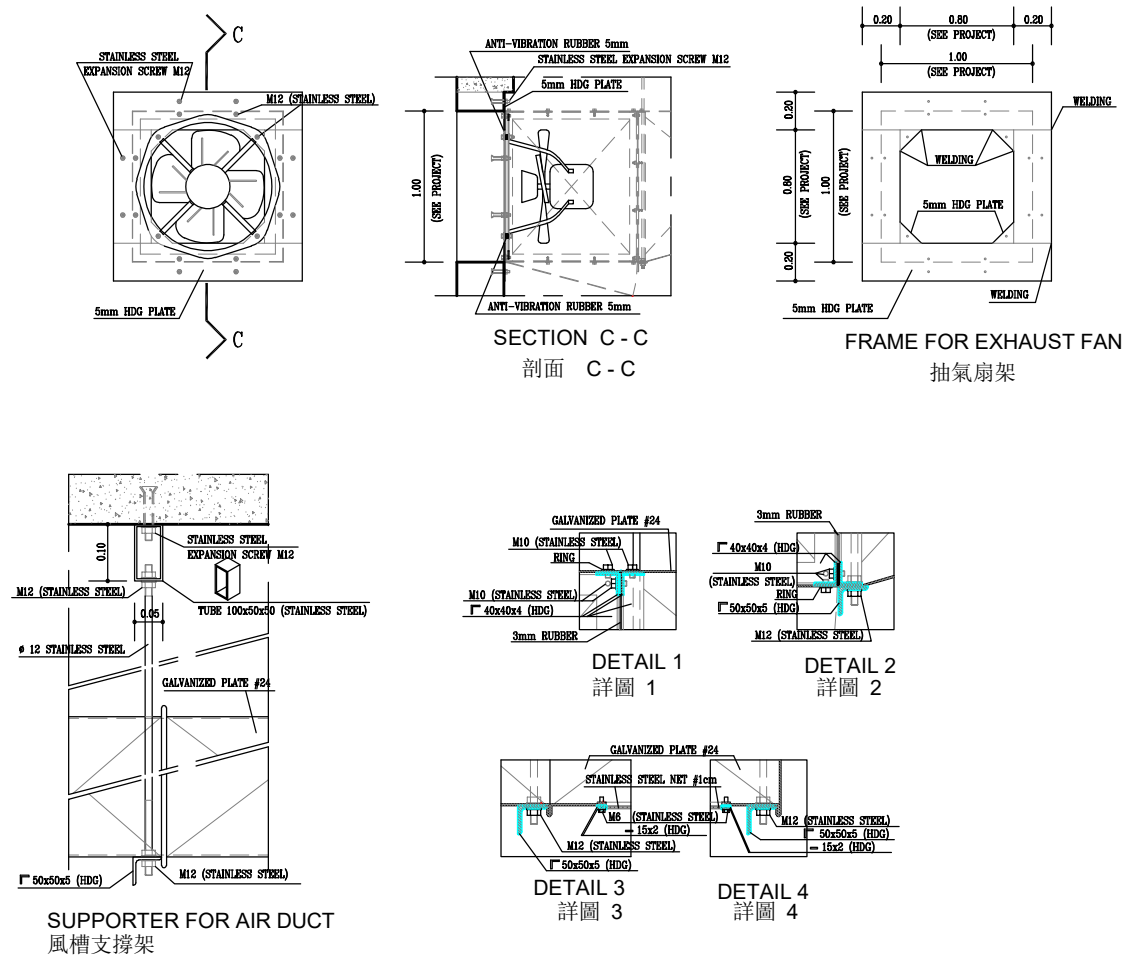

| | | | | | |
|---|------------|--|--------|---------|---------|
| D | 16/08/2022 | Modify the specification for exhaust fan | Hou | Albert | Luella |
| C | 01/08/2008 | Change the size | Hou | Tavares | Tavares |
| B | 05/12/2001 | Change the position of anti-vibration rubber | Hou | Eddey | Kin |
| A | 22/10/2001 | Change the exhaust fan | Hou | Eddey | Kin |
| | Date | Modification | Draft. | Verif. | Approv. |

| | | | | |
|--|---------|------------|--|---|
| Draft. | Hou | 06/06/1995 | Customer Substation (P.T.) Civil Construction |  |
| Verif. | Wanda | 06/06/1995 | | |
| Approv. | | | | |
| Air duct for stand-alone outdoor customer substation for temporary construction 用於臨時工地的獨立變電房的風管 | | | TAD | |
| Scale 1 : 6 & 1 : 20 | Remarks | | Job N ^o | |