



DETAIL A 詳圖 A
SCALE 1 : 5 比例 1 : 5

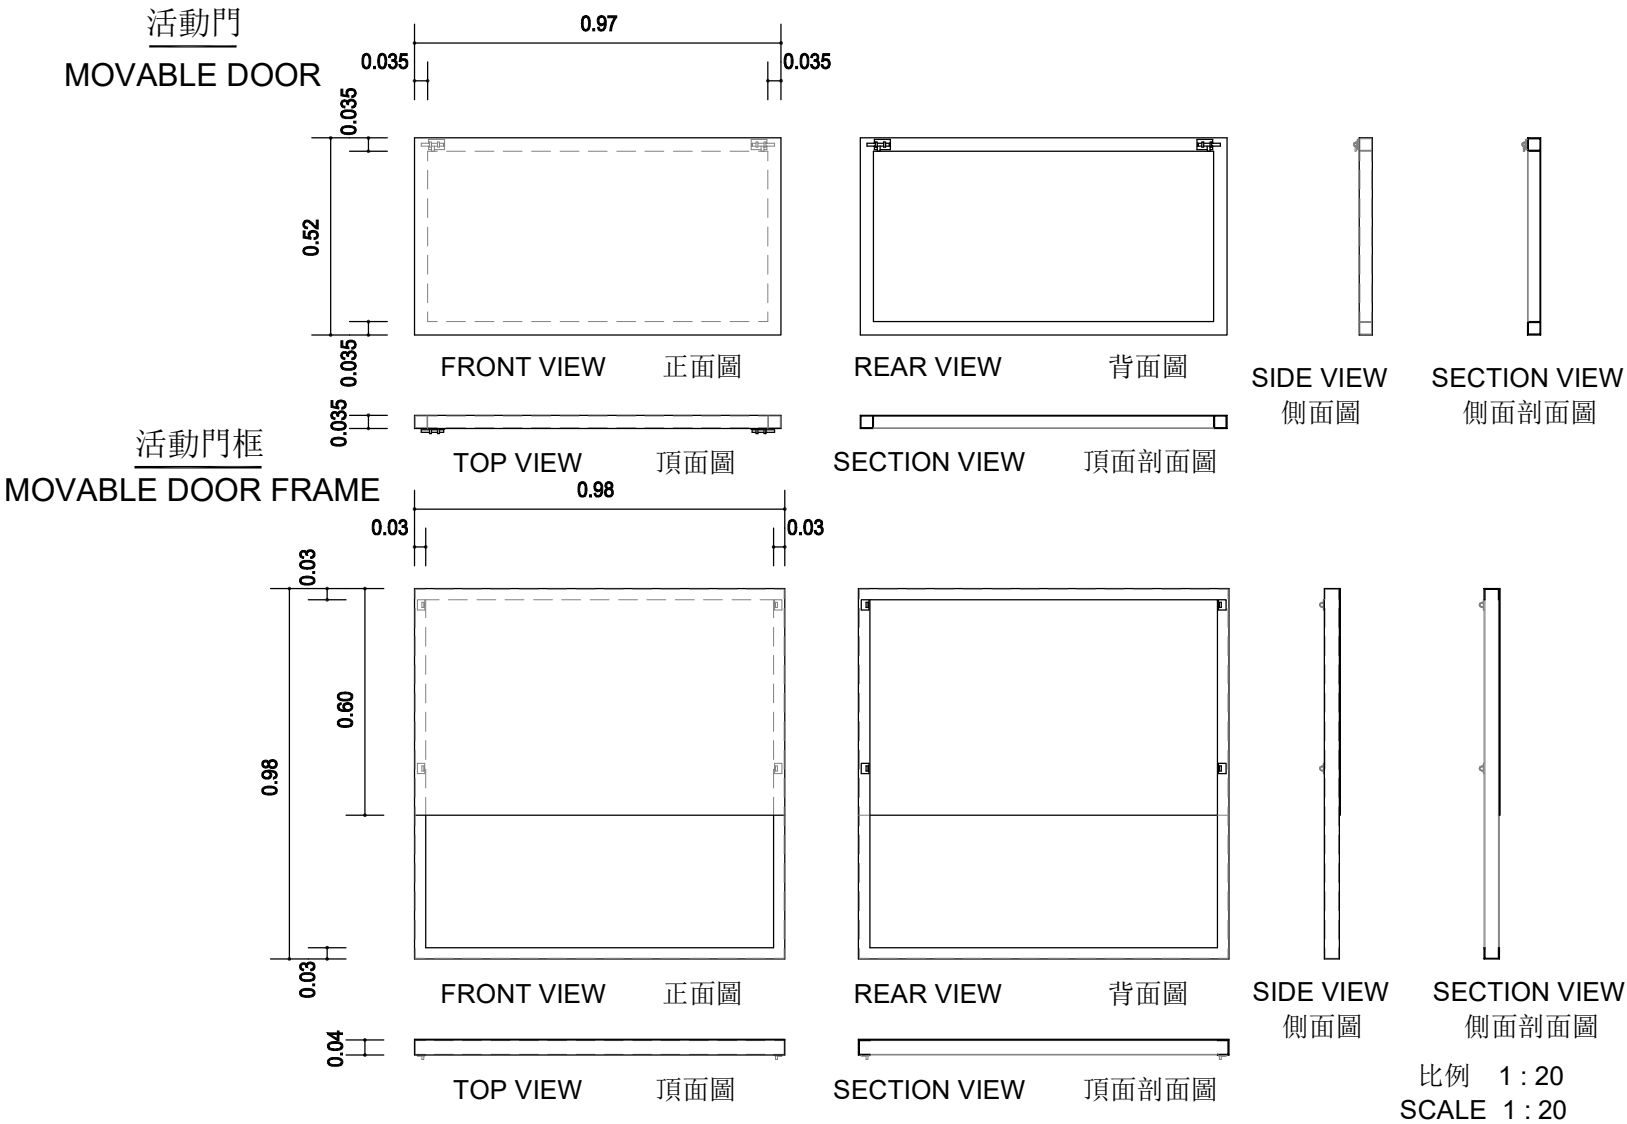

NOTE 注意	
All cable pipes can be cover by moving plate 所有電纜管可被活動板覆蓋	Movable plate with earthing point and drainage 活動板有接地線耳和去水線
All structure in stainless steel 2mm thick 所有材料要用不鏽鋼2mm厚	All screws and expansion screws fix with rings 安裝所有螺絲要用介子
All structure in stainless steel of the low carbon type AISI316L 所有材料要用不鏽鋼 AISI316L	All screws and expansion screws must be stainless steel 安裝所有螺絲要用不鏽鋼品種

D					
C					
B					
A					
	Date	Modification			Draft. Verif. Approv.

Draft.	Hou	10/03/2025	Customer Substation (P.T.) Civil Construction		
Verif.	Hugo	10/03/2025			
Approv.	Luella	10/03/2025			
Movable outgoing cable door 活動式出線門				TAD	
Scale 1 : 20		Remarks		Job Nº	Drawing Nº D-364/2